






## VACCINATION IN DRINKING WATER Step-by-step administration guide

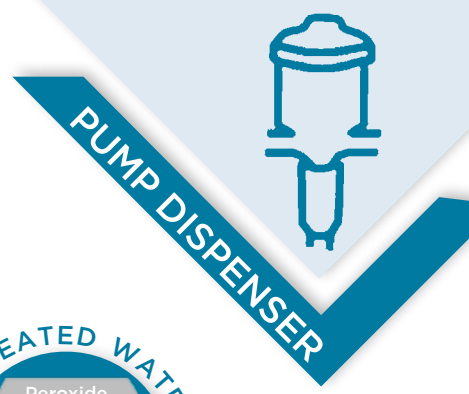

### Reconstitution of the oral vaccine

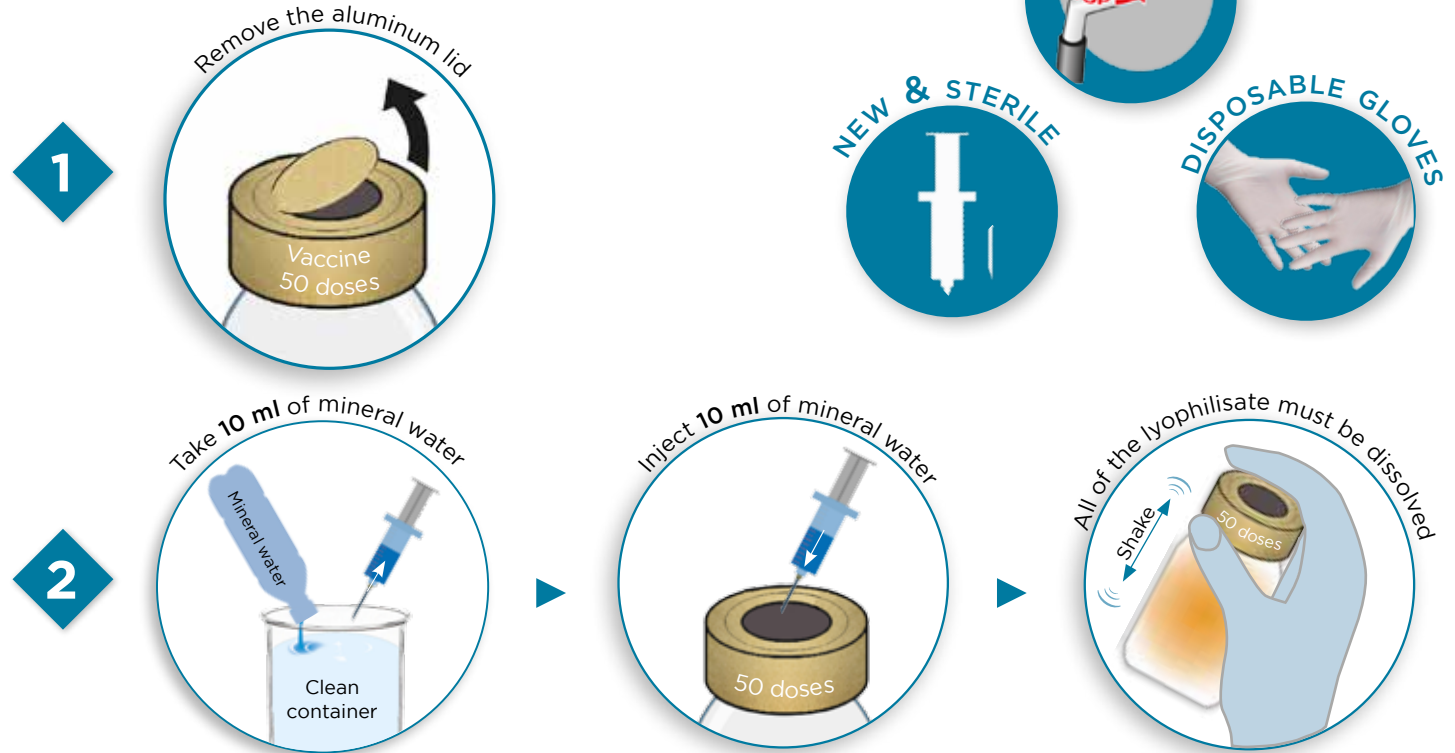

Repeat steps 1 and 2 according to the number of piglets to be vaccinated (see table on the back)

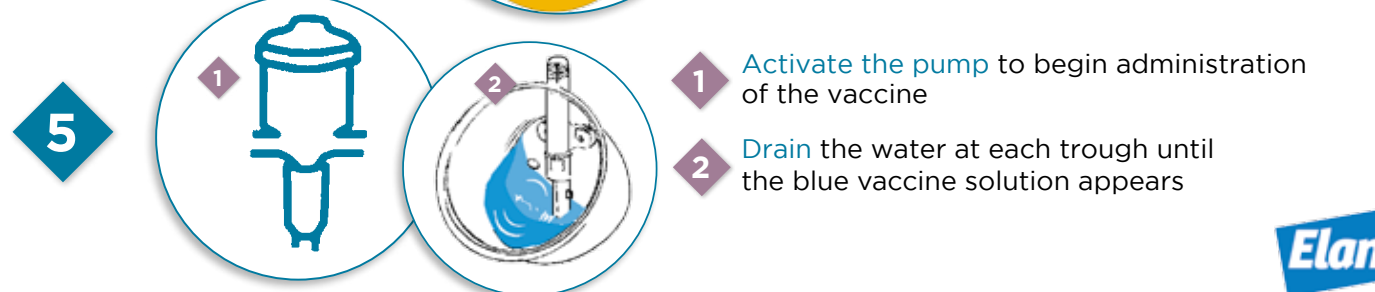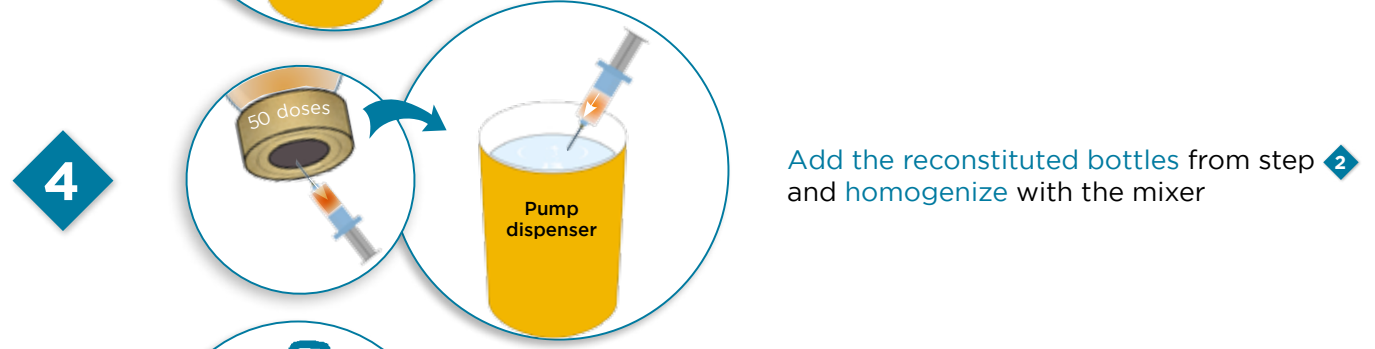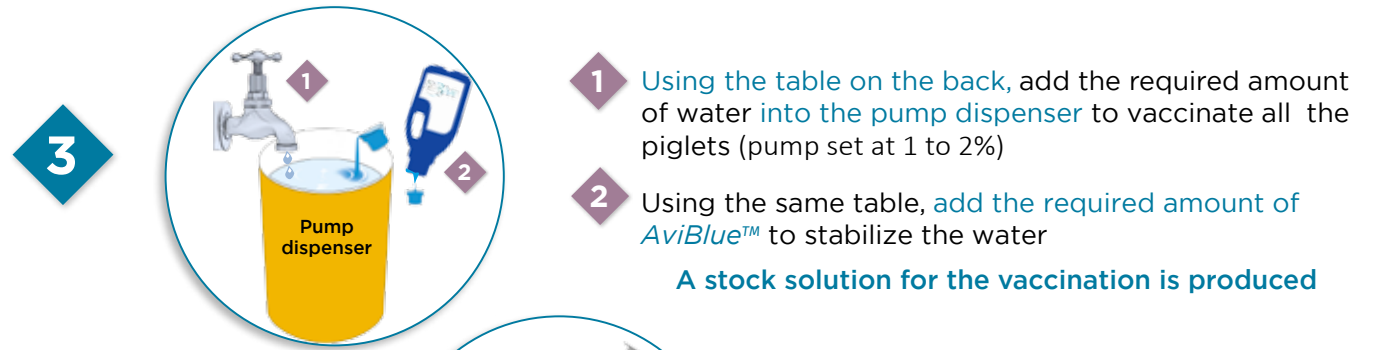

# Dosage Guide

Pump dispenser adjusted to 1 to 2%

► It is strongly recommended to assess the actual water consumption over a period of 4 hours, one day prior to vaccination. Otherwise, use the table below.



PUMP DISPENSER

## Weaning 21 days

Average weight 6 kg


Number of piglets	Number of vials to be prepared	Water consumed in 4 hours (litres)	Water to be added in the pump dispenser (litres)	Quantity of <i>AviBlue</i> <sup>TM</sup> Water to be added in the pump dispenser (grams) <sup>1</sup>
50	1	8.5	0.43	4.3
100	2	17	0.85	8.5
150	3	25.5	1.28	12.8
200	4	34	1.70	17.0
250	5	42.5	2.13	21.3
300	6	51	2.55	25.5
350	7	59.5	2.98	29.8
400	8	68	3.40	34.0
450	9	76.5	3.83	38.3
500	10	85	4.25	42.5
550	11	93.5	4.68	46.8
600	12	102	5.10	51.0
650	13	110.5	5.53	55.3
700	14	119	5.95	59.5
750	15	127.5	6.38	63.8
800	16	136	6.80	68.0
850	17	144.5	7.23	72.3
900	18	153	7.65	76.5
950	19	161.5	8.08	80.8
1000	20	170	8.50	85.0

## Weaning 28 days

Average weight 8 kg

Number of piglets	Number of vials to be prepared	Water consumed in 4 hours (litres)	Water to be added in the pump dispenser (litres)	Quantity of <i>AviBlue</i> <sup>TM</sup> Water to be added in the pump dispenser (grams) <sup>1</sup>
50	1	11.5	0.58	5.8
100	2	23	1.15	11.5
150	3	34.5	1.73	17.3
200	4	46	2.30	23.0
250	5	57.5	2.88	28.8
300	6	69	3.45	34.5
350	7	80.5	4.03	40.3
400	8	92	4.60	46.0
450	9	103.5	5.18	51.8
500	10	115	5.75	57.5
550	11	126.5	6.33	63.3
600	12	138	6.90	69.0
650	13	149.5	7.48	74.8
700	14	161	8.05	80.5
750	15	172.5	8.63	86.3
800	16	184	9.20	92.0
850	17	195.5	9.78	97.8
900	18	207	10.35	103.5
950	19	218.5	10.93	109.3
1000	20	230	11.50	115.0

To help you to measure *AviBlue*<sup>TM</sup>

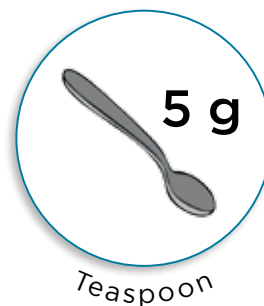

1. L. Bélanger et al. 2017. In vitro investigation on the compatibility of Coliprotec<sup>TM</sup> F4/F18, live oral *E. coli* vaccine against post-weaning diarrhoea, and Aviblu water stabilizer. Proceedings of the 9th European Symposium of Porcine Health Management, 3-5 May Prague, Czech Republic,

Coliprotec F4/F18 is an oral vaccine used for active immunization of pigs from 18 days of age against enterotoxigenic F4-positive and F18-positive *Escherichia coli* in order to reduce the incidence of moderate to severe post-weaning diarrhoea infected pigs and reduce the faecal shedding of enterotoxigenic F4- positive and F18-positive *E. coli* from infected pigs. Each dose of vaccine contains 1.3 x 10<sup>8</sup> to 9.0 x 10<sup>8</sup> CFU of live non-pathogenic *Escherichia coli* O8:K87 (F4ac) and 2.8 x 10<sup>8</sup> to 3.0 x 10<sup>9</sup> CFU of live non-pathogenic *Escherichia coli* O141:K94 (F18ac). Refer to the product packaging and leaflets for information about side effects, precautions, warnings and contraindications. Legal category POM-V. Advice should be sought from the Medicine Prescriber.

For further information consult the product SPC. Elanco UK AH Limited, Form 2, Bartley Way, Bartley Wood Business Park, Hook RG27 9XA. Telephone: 01256 353131 Email: elancouk@elanco.com Coliprotec, Elanco and the diagonal bar logo are trademarks of Elanco or its affiliates. ©2024 Elanco or its affiliates. Use medicines responsibly www.noah.co.uk/responsible. Date of preparation: 03/24 PM-UK-20-0183